




TUCSON WATER OWNED AND MAINTAINED WATER METER
WITH TUCSON WATER OWNED AND MAINTAINED
RP BACKFLOW ASSEMBLY

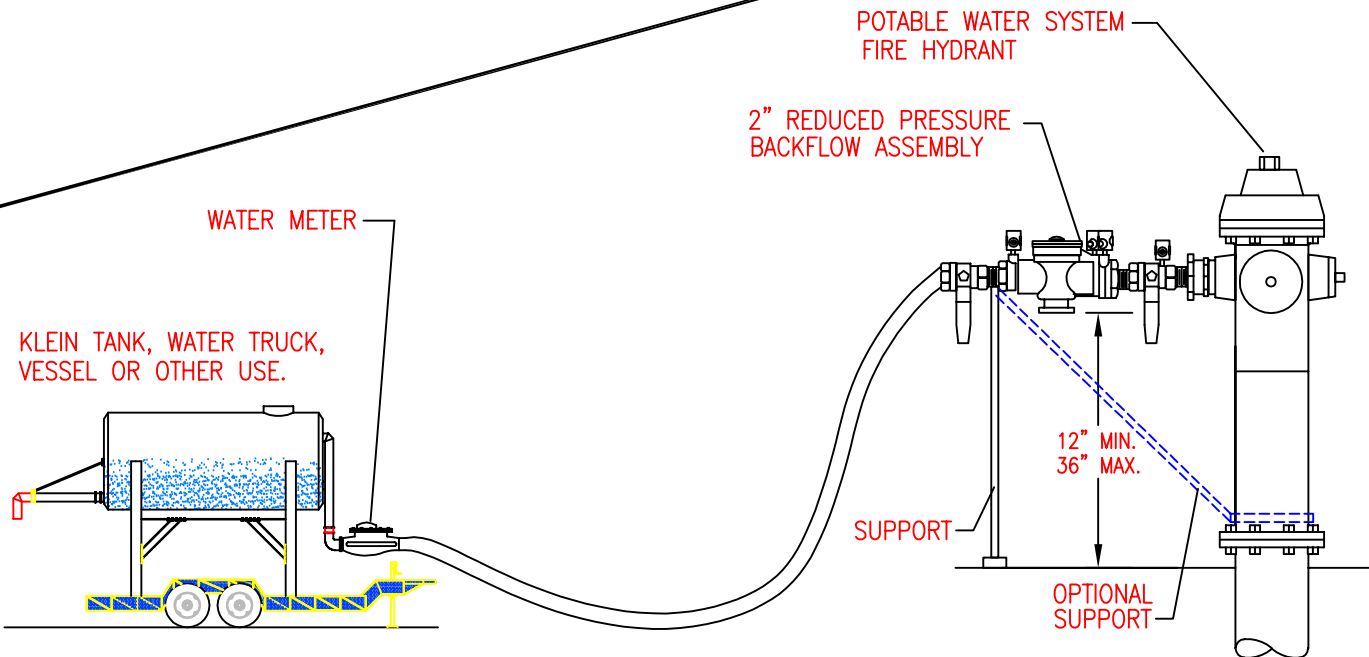

CONTRACTOR OWNED AND MAINTAINED WATER METER
WITH CONTRACTOR OWNED AND MAINTAINED
RP BACKFLOW ASSEMBLY

Notes:

1. All backflow assemblies shall be installed, maintained and tested in accordance with regulations.
2. Only one connection per hydrant is allowed unless otherwise authorized by Tucson Water.
3. For a list of approved backflow assemblies or further information contact the Backflow Section at 520-791-2650.

ISSUED:		STANDARD DETAIL		DETAIL NO.
8/00		BACKFLOW PREVENTION FOR POTABLE WATER FIRE HYDRANT OR STANDPIPE WATER SERVICE		SD-1801
REVISED:				SHEET 1 OF 1
8/01				